


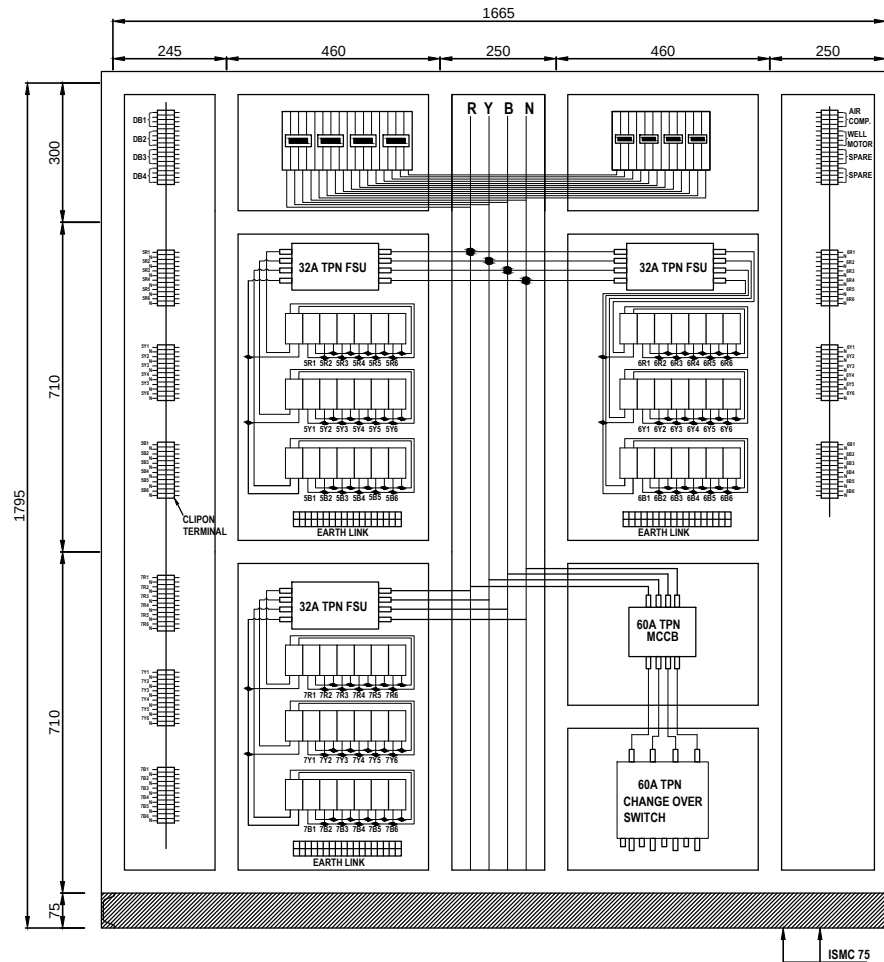

SECTIONAL ELEVATION

LEGEND

MAIN BUSBAR 25 x 3 MM CU.
NEUTRAL 25 x 3 MM CU.
MAIN EARTH CONDUCTOR 25 x 3 MM CU.
SHEET THICKNESS 16 GAUGE
CABLE ENTRY BOTTOM

ALL SWITCH GEARS SHOULD BE EARTHENED USING 25 x 3MM CU. AND THAT SHOULD BE CONNECTED TO THE MAIN EARTH CONDUCTOR.



LANKA IOC PLC

DRAWING TITLE :

M.V PANEL BOARD DETAIL
TYPE-02

DRAWN BY :SHANTHA DATE :18-02-2014

DESIGN BY :RANGANA CHECKED :

SCALE : AS SHOWN JOB NO. : LIOC

DRAWING NO. : LIOC/ENG/STD/28-III

CAD FILE :LANKA IOC/STD DRAWING